


SPRINKLERS  
HOSE CONNECTION  
(NO HOSES)  
NO FIRE HYDRANTS

COMBINATION WATER LINE MUST BE  
BE CLASS 52 DUCTILE, OR COPPER OR  
EQUAL TESTED & SAMPLED IN SAME  
MANNER AS DOMESTIC WATER MAIN.

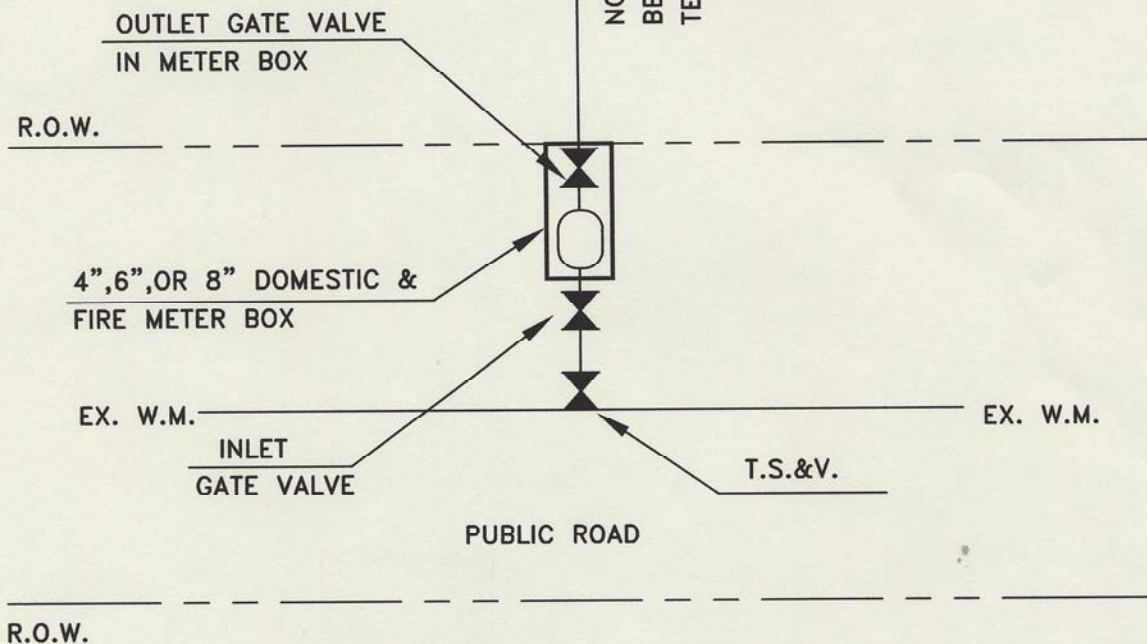

METRO WATER SERVICES

4", 6" OR 8" COMBINATION  
DOMESTIC FIRE SERVICE

NOT TO SCALE DATE: 2/25/05

DWG. NO. SHEMATIC 4

**METRO**  
WATER SERVICES

*Hal Battthrop*  
LICENSED DISTRIBUTION OPERATOR

*[Signature]*  
DIRECTOR OF WATER AND SEWERAGE SERVICES